

Particle Swarm Optimization Technique for Photovoltaic System

Md. Fahim Ansari, Padmanabh Thakur, Parvesh Saini

Abstract: Day by day the dependency on renewable energy uses has been increasing because of no greenhouse emission and abundant in nature available freely, this paper, presents a comparative analysis of an optimization technique called Particle Swarm Optimization (PSO) along with Perturb & Observe (P&O) for the extraction of maximum power from the PV panel. The performances of P&O and PSO techniques were compared for different insulations and temperatures. A detailed and rigorous mathematical model along with simulation results and its performance for maximum power extraction from the panel were analyzed by using P&O and PSO. It has been observed that the maximum power obtained from PSO model is more than the maximum power obtained from P&O for different insulations and temperatures. Thus PSO is much better and more suitable for extracting maximum power from PV system.

Keywords: Particle Swarm Optimization, maximum power point tracker, buck boost Converter, Perturb & Observe

I. INTRODUCTION

The continuous use of fossil fuels has caused the fossil fuel deposit to be reduced and drastically affected the environment depleting the biosphere and cumulatively adding to global warming. As conventional remnant fuels are expected to come to an end in the near future, the world recent research increasing exponentially in renewable energy such as solar, wind, geothermal, biomass etc. [1]-[2]. Solar energy is being getting more popular because it is available in abundant and also freely, most of the part of India got 300 sunny days [3]-[4]. Solar energy is a good choice for electric power generation, since the solar energy is directly converted into electrical energy by solar photovoltaic modules. The current capacity of solar PV system depends on its area exposed to sun light and if area is more the current capacity is also more and if area is less the current capacity is also less [5]. PV array is formed when PV modules are connected in series and parallel which is connected as per power requirement capacity [6]-[9]. In literature many optimization methods such as Perturb and observe, Incremental conductance: Fractional open circuit voltage: Fractional open circuit voltage: Artificial intelligent techniques: Fuzzy Logic Controller, has been discussed. Particle Swarm Optimization [10] is an approach to optimize the solar MPPT. The PSO algorithm is used to minimize the cost of the generated energy for the matching of electricity supply and local demand [11].

Revised Manuscript Received on January 15, 2020

Md. Fahim Ansari, Department of Electrical Engineering, Graphic Era Deemed to be University, Dehradun (India)
email- engineer.19781234@gmail.com , tonu_arth@rediffmail.com

Padmanabh Thakur, Department of Electrical Engineering, Graphic Era Deemed to be University, Dehradun (India)
email- engineer.19781234@gmail.com , tonu_arth@rediffmail.com

Parvesh Saini, Department of Electrical Engineering, Graphic Era Deemed to be University, Dehradun (India)
email- engineer.19781234@gmail.com , tonu_arth@rediffmail.com

Particle Swarm Optimization (PSO) technique is being used in solar PV system to produce constant output voltage from converter. The application of PSO greatly improves the performance of MPPT and supply enhanced output power [12-14]. The reduction in total power generation by entire PV system is being reduces due to mismatch in panel design, grading and partial shading. So its efficiency is also being greatly affected [15-16]. So appropriate tracking system along with optimization technique are needed. maximum power point tracking (MPPT). To examine the usefulness of the projected technique, MATLAB simulations are conceded out under varying conditions, of irradiance, temperature changes, of the PV arrays. Maximum output power is extracted from the PV panel for different insolation and temperature using P&O and PSO MPPT techniques. Since PSO is more advanced optimization technique than P & O, therefore its result is much better than P & O. The power obtained from PSO model is more than the power obtained from P & O model, which has been discussed in the following sections.

II. MATHEMATICAL MODEL OF SOLAR CELL

The equivalent circuit of solar cell has been discussed in this section which is a current source connected across a diode, shunt resistance (R_{sh}) and series resistance (R_s). The equivalent circuit is shown in fig 1.

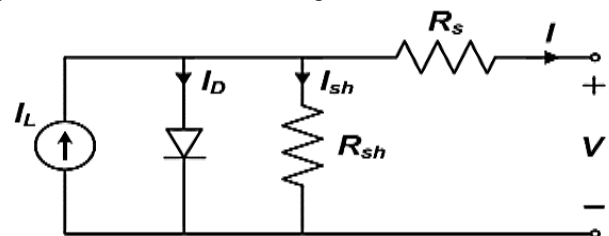


Fig.1. Equivalent circuit of Solar Cell

Where, R_s = series resistance, it is the resistance offered by bulk material to flow of electrons and the resistance between the bulk material and the metal contact and it is in series with load resistance.

R_{sh} = shunt resistance, it is the resistance caused by recombination process inside the PV cell.

Diode current is given by

$$I_D = I_o \left(e^{\frac{qV_D}{kTY}} - 1 \right) \quad (1)$$

Relationship between V_L and I_L seen from the load (neglecting shunt resistance) is given as follows

$$I_{ph} - I_D = I_L \quad (2)$$

$$I_{ph} - I_o \left(e^{\frac{qV_D}{kTY}} - 1 \right) = I_L \quad (3)$$

Put $(V_D = V_L + R_S I_L)$ in equation(iii)

$$I_{ph} - I_o \left(e^{\frac{q[V_L + R_S I_L]}{YKT}} - 1 \right) = I_L \quad (4)$$

Rearranging and taking log on both sides, we get

$$\ln \left(\frac{I_{ph} - I_L}{I_o} + 1 \right) = \frac{q(V_L + R_S I_L)}{YKT} \quad (5)$$

Again rearranging, we get

$$V_L = \frac{YKT}{q} \ln \left(\frac{I_{ph} - I_L}{I_o} + 1 \right) - R_S I_L \quad (6)$$

Open circuit voltage or Maximum Voltage ($I_L=0$) is given by

$$V_{Lmax} = \frac{YKT}{q} \ln \left(\frac{I_{ph}}{I_o} + 1 \right) \quad (7)$$

Relation between V_L and I_L seen from load (considering shunt resistance) is given as follows

$$I_{ph} - I_D - I_{sh} = I_L \quad (8)$$

$$I_{ph} - I_o \left(e^{\frac{qV_D}{YKT}} - 1 \right) - \frac{V_D}{R_{sh}} = I_L \quad (9)$$

Put $(V_D = V_L + R_S I_L)$ in equation (9)

$$I_{ph} - I_o \left(e^{\frac{q[V_L + R_S I_L]}{YKT}} - 1 \right) - \frac{(V_L + I_S R_L)}{R_{sh}} = I_L \quad (10)$$

Where

$I_{ph} = I_{SC} =$ Photon Current/ Short Circuit Current

$I_o =$ Reverse Saturation Current

$I_D =$ Diode Current

$I_L = I_S =$ Load Current/Series Current

$V_D =$ Diode Voltage

$V_L =$ Load Voltage

$V_{Lmax} =$ Maximum Voltage/ Open Circuit Voltage

$R_S =$ Series Resistance

$R_{sh} =$ Shunt Resistance

$q =$ Electron Charge

$K =$ Boltzmann's Constant

$T =$ Absolute Temperature

$\gamma =$ Cascading Constant (value lies between 1 to 3)

III. SYSTEM DESIGN IN MATLAB

In both models PSO and P&O, three blocks such as PV panel, MPPT block and Buck-boost converter were considered and are shown in Figure 2 and Figure 3.

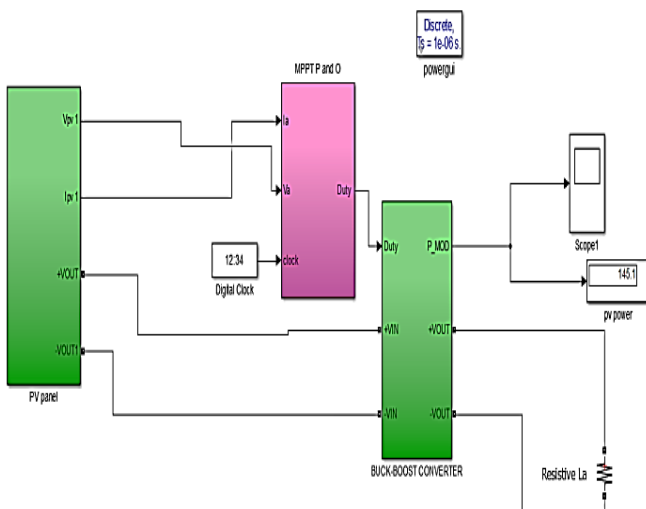


Fig. 2. Simulation Diagram of P & O MPPT Model

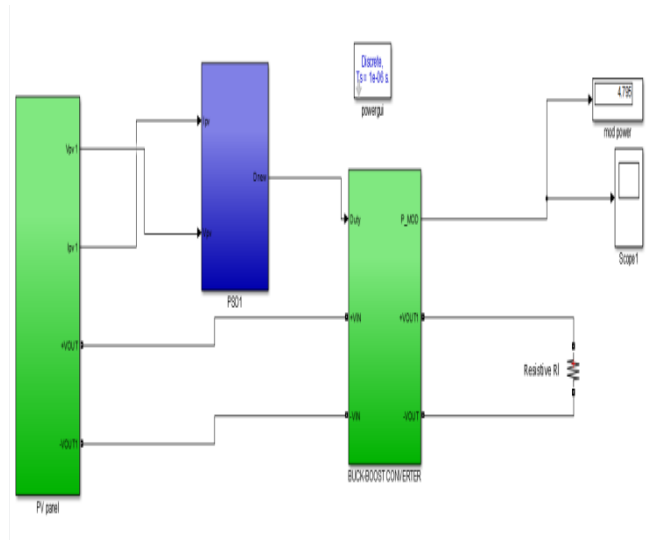


Fig. 3. Simulation Diagram of PSO MPPT Model

IV. RESULT ANALYSIS OF PSO WITH P&O METHOD

The comparative results between PSO and P & O MPPT technique applied of photovoltaic system has been given from figure 4 to figure 11. Maximum output power is extracted from the PV panel for different insolation and temperature using P&O and PSO MPPT techniques.

The present work compares the results obtained from PSO and P&O MPPT model for different insolation and temperature. Results for the above models are shown below from figure 4 to figure 11 considering temperature variations from 25°C to 50°C and insolation variation from 1000 W/m² to 1500 W/m². In all the cases it has been observed that the response using PSO method is far better than using P&O techniques. Result analysis is also presented in the form of table 1 to table 4. The error is depicted in the table using PSO and P&O techniques.

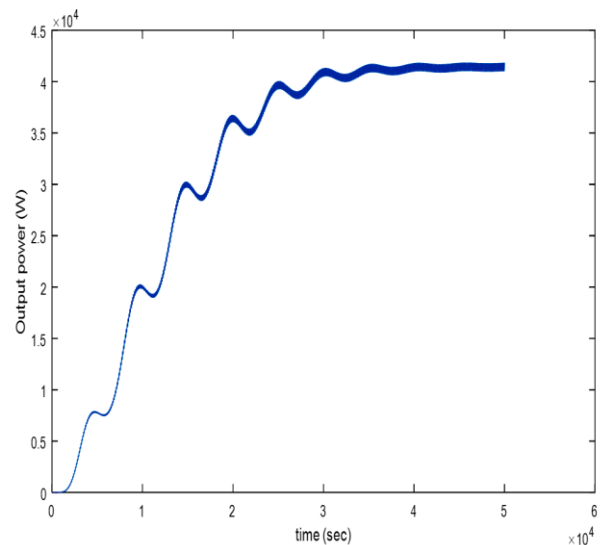


Fig. 4. Output power curve of PSO model at constant insolation 1000W/m² and varying temperature up to 25°C

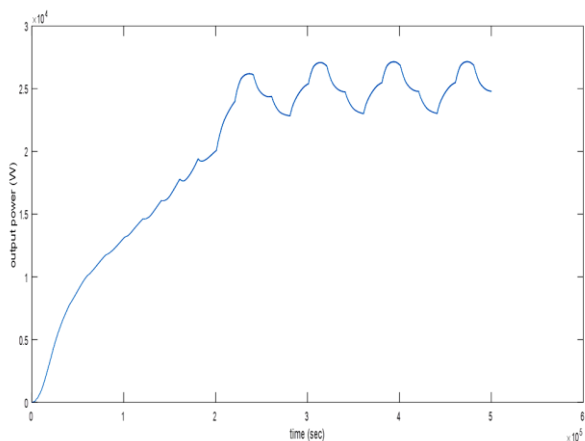


Fig. 5. Output power curve of P&O model at constant isolation 1000W/m² and varying temperature up to 25⁰C

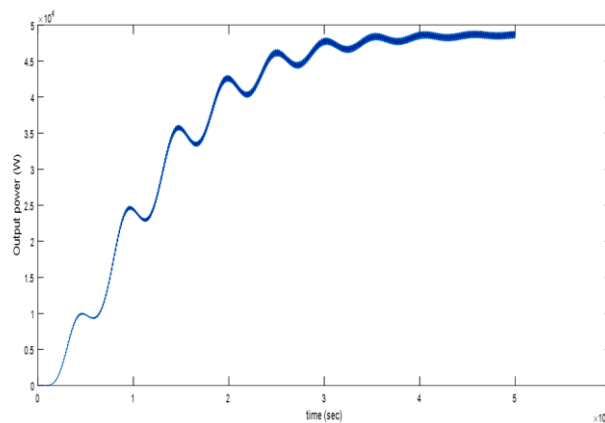


Fig. 8. Output power curve of PSO model at constant temperature 25⁰C and varying isolation up to 1000 W/m²

Table- I: Results of PSO and P&O models constant isolation 1000W/m² and varying temperature up to 250C

Technique used	Pmpp(Calculated)	Pmpp(actual)	Error	Duty cycle
PSO	4.18e04 W	4.2e04 W	0.004	0.65
P & O	2.66e04 W	4.2e04 W	0.36	0.37

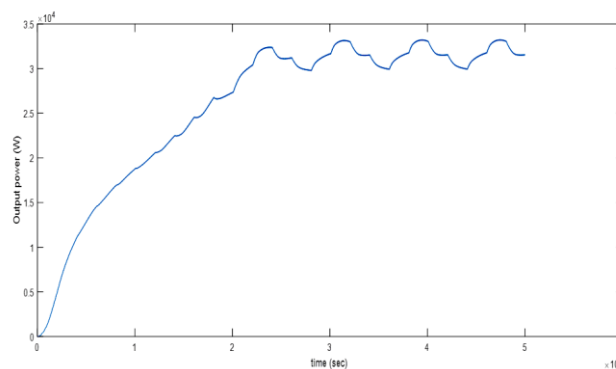


Fig. 9. Output power curve of P & O model at constant temperature 25⁰C and varying isolation up to 1000 W/m²

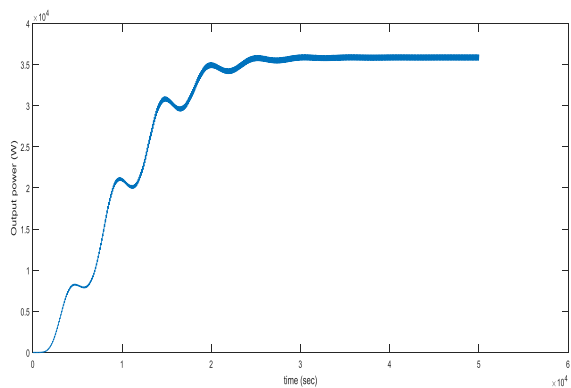


Fig. 6. Output power curve of PSO model at constant isolation 1000W/m² and varying temperature up to 50⁰C

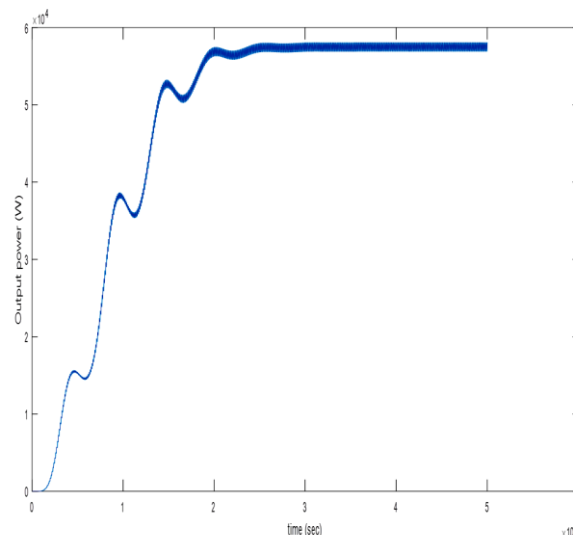


Fig. 10. Output power curve of PSO model for constant temperature 50⁰C and varying isolation up to 1000 W/m²

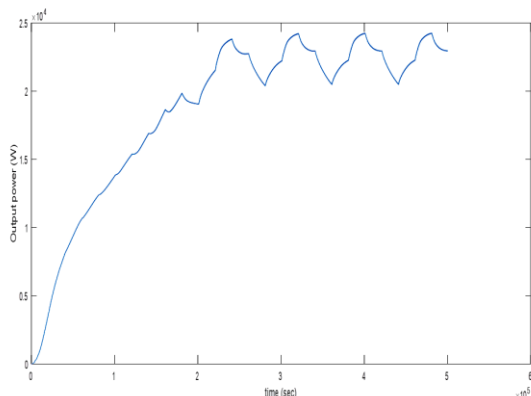


Fig. 7. Output power curve of P & O model at constant isolation 1000W/m² and varying temperature up to 50⁰C

Table- 2: Results of PSO and P&O models at constant isolation 1000W/m² and varying temperature up to 500C

Technique used	Pmpp(Calculated)	Pmpp(actual)	Error	Duty cycle
PSO	3.62e04 W	3.81e04 W	0.049	0.65
P & O	2.294e04 W	3.81e04 W	0.39	0.37

Table- 3: Results of PSO and P&O models at constant temperature 25⁰C and varying isolation up to 1000 W/m²

Technique used	Pmpp(Calculated)	Pmpp(actual)	Error	Duty cycle
PSO	4.916e04 W	5.21e04 W	0.057	0.687
P & O	3.233e04 W	5.21e04 W	0.37	0.37

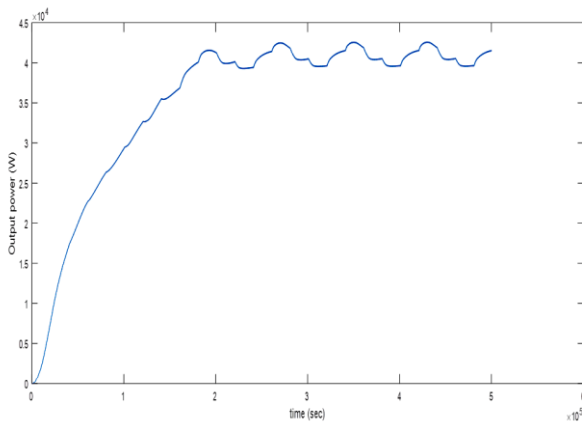


Fig. 11. Output power curve of P&O model for constant temperature 50°C and varying isolation up to 1000 W/m²

Table- 4: Results of PSO and P&O models at constant temperature 50°C and varying isolation up to 1000 W/m²

Technique used	Pmpp(Calculated)	Pmpp(actual)	Error	Duty cycle
PSO	5.808e04 W	6.001e04 W	0.032	0.687
P & O	4.151e04 W	6.001e04 W	0.308	0.37

In this work MATLAB Simulink has been used and compared the performance of their results for P&O, PSO for different temperature and isolation. After going through the results it can be concluded (table 4) that output power obtained from PSO model is much higher than the power obtained from P&O model for different insolation and temperature. Therefore, PSO MPPT technique is much better than P&O MPPT technique.

V. CONCLUSION

P&O and PSO MPPT techniques were reviewed. The performances of P & O and PSO techniques were compared for different insolation and temperature. After running simulation of both MPPT models, it has been found that the maximum power obtained from PSO model is more than the maximum power obtained from P&O for different insolation and temperature. Thus it can be concluded that PSO is much better and more suitable for extracting maximum power from PV system.

REFERENCES

1. M.G.Villalva, J.R.Gazoli and E. Ruppert F. "Comprehensive Approach to Modeling and Simulation of Photovoltaic Arrays". IEEE Transactions on power electronics. Vol.24, NO. 5, 2009. pp 1198 – 1208.
2. W. Jing, C. Hung Lai, S. H. W. Wong and M. L. D. Wong, "Battery-supercapacitor hybrid energy storage system in standalone DC microgrids: a review," in *IET Renewable Power Generation*, vol. 11, no. 4, pp. 461-469, 15 3 2017. doi: 10.1049/iet-rpg.2016.0500A. Safari and S. Mekhilef, "Simulation and hardware implementation of incremental conductance MPPT with direct control method using cuk converter," IEEE Trans. Ind. Electron., vol. 58, no. 4, pp. 1154-1161, Apr. 2011
3. R. Ramakumar, H. J. Allison and W. L. Hughes, "Solar energy conversion and storage systems for the future," in *IEEE Transactions on Power Apparatus* 94, no. 6, pp. 1926-1934, Nov. 1975. doi: 10.1109/T-PAS.1975.32038
4. M. N. Akhter, S. Mekhilef, H. Mokhlis and N. Mohamed Shah, "Review on forecasting of photovoltaic power generation based on machine learning and metaheuristic techniques," in *IET Renewable Power Generation*, vol. 13, no. 7, pp. 1009-1023, 20 5 2019. doi: 10.1049/iet-rpg.2018.5649
5. U. Akram, M. Khalid and S. Shafiq, "Optimal sizing of a wind/solar/battery hybrid grid-connected microgrid system," in *IET*

6. *Renewable Power Generation*, vol. 12, no. 1, pp. 72-80, 8 1 2018. doi: 10.1049/iet-rpg.2017.0010
7. Y. Bo, L. Wuhua, Z. Yi, and H. Xiangning, "Design and analysis of a grid connected photovoltaic power system," IEEE Trans. Power Electron., vol. 25, no. 4, pp. 992-1000, Apr. 2010.
8. U. Jadli, P. Thakur and R. D. Shukla, "A New Parameter Estimation Method of Solar Photovoltaic," in *IEEE Journal of Photovoltaics*, vol. 8, no. 1, pp. 239-247, Jan. 2018. doi:10.1109/JPHOTOV.2017.2767602
9. P. Shaw, "Modelling and analysis of an analogue MPPT-based PV battery charging system utilising dc-dc boost converter," in *IET Renewable Power Generation*, vol. 13, no. 11, pp. 1958-1967, 19 8 2019. doi: 10.1049/iet-rpg.2018.6273
10. Mohamed, A.; Eltamaly, A.; Alolah, I. Swarm intelligence-based optimization of grid-dependent hybrid renewable energy systems. *Renew. Sustain. Energy Rev.* 2017, 77, 515-524.
11. K. A. K. Niazi, Y. Yang and D. Sera, "Review of mismatch mitigation techniques for PV modules," in *IET Renewable Power Generation*, vol. 13, no. 12, pp. 2035-2050, 9 9 2019. doi: 10.1049/iet-rpg.2019.0153
12. Eltamaly, A.; Mohamed, A. A novel design and optimization software for autonomous PV/wind/battery hybrid power systems. *Math. Probl. Eng.* 2014, 2014, 637174.
13. Cho, M.Y., Hoang, T.T.. Feature Selection and Parameters Optimization of SVM Using Particle Swarm Optimization for Fault Classification in Power Distribution Systems. *Computational Intelligence and Neuroscience*, <https://doi.org/10.1155/2017/4135465>. 2017
14. Sun Q., Huang B., D. Li, D. Ma and Y. Zhang, "Optimal placement of energy storage devices in microgrids via structure preserving energy function," IEEE Transactions on Industrial Informatics, vol. 12, Issue. 3, June 2016, pp. 1166-1179.
15. A. K. Podder, N. K. Roy and H. R. Pota, "MPPT methods for solar PV systems: a critical review based on tracking nature," in *IET Renewable Power Generation*, vol. 13, no. 10, pp. 1615-1632, 29 7 2019. doi: 10.1049/iet-rpg.2018.5946
16. O. B. Belghith, L. Sbita and F. Bettaher, "MPPT Design Using PSO Technique for Photovoltaic System Control Comparing to Fuzzy Logic and P&O Controllers", *Energy and Power Engineering*, 2016

AUTHORS PROFILE



Dr Md Fahim Ansari, presently working as professor in Graphic Era Deemed to be University Dehradun, He did B.Tech from MIT, M.Tech From AMU Aligarh and PhD from NITTTR Chandigarh. He has published more than 22 papers in SCI/Scopus Journals and conferences. He has also works as Professor in Buraydah Engineering College Saudi Arabia. He is reviewer of Elsevier, IEEE journals



Padmanabh Thakur, presently working as Professor and Head, Electrical Engineering Department, Graphic era Deemed to be University Dehradun. He received the Bachelor of Tech. in Electrical Engineering from MIT, Muzafferpur (Bihar) in 1997, Masters of Technology in Electrical Engineering from RVDU, Udaipur, and the Ph.D. in Electrical Engineering from MNNIT, Allahabad, India, in 2014. He is an eminent researcher and has numerous research publications published in various journals of repute.



Parvesh Saini, presently working as Assistant Professor in Electrical Engineering Department, Graphic era Deemed to be University Dehradun. He received the Bachelor of Tech. in Instrumentation and Control Engineering from Kurukshetra University, Kurukshetra (Haryana) in 2004, Masters of Technology in Instrumentation and Control Engineering from Panjab University, Chandigarh in 2008, and pursuing Ph.D. in Control Engineering from Graphic Era deemed to be University, Dehradun. He has numerous research publications published in various journals and conferences of repute.