

Forecast of Corona Losses using Grey Wolves on Variant Load Condition

Manoj Sharma, Anand Mohan, Arun Kumar Sharma

Abstract-Depending upon material science law and guidelines, the factors of overhead lines in network, electric and meteorological data recorded the essential relationships with the corona losses and the states of climate are normally spotted. Corona losses occurred to be characterized just by weighting components for particular states of climate of average twelve Bulgarian territories showing components of complete transmission lattice. A determining unit imply on a measurable procedure worried on an hourly premise corona shortfall is inspected and proposed to have the option to decrease the lopsided characteristics costs. This casing work includes a proposed model of learning for limiting the corona losses. The deficiencies of suggested approach lessen in each situation since it speaks to an effective learning adaptation and at the hour of testing it productively figure heat/temperature giving an extraordinary effect to fundamentally losses decrease. The fundamental purpose for the improvement of learning approach is that the learning approach sums up the information however expectation approach utilizes dynamic choice and disregards past information execution.

Keywords- Corona, corona release, Artificial Neural Network (ANN), Load

I. INTRODUCTION

In absurd voltage transmission lines inferable from the ionization of air close the conductor can get empowered, so there are mishaps named as corona incidents [1]. This twisting reasons unexpected littler in comparison to ordinary constrained breakdowns inside the wrapping air segment inferable from that you'll anticipate a violet sparkle and a mumbling disturbance. along these lines of miracle brings some electrical essentialness midway dispatch, usually called corona or corona dispatch. Electrical transmission lines will give heap of sound vitality considering corona. Corona is solely a startling related to the sum of the lines of transmission. underneath express things, the electrical subject (close by) shut vitalized channels and fixings may develop to some degree electric supercharged discharge or corona that triggers the broad of air build up to ask ionized, or fitness minor controlled electrical rate exchange [2][10]. Utility workplaces expect to lessen the measure of corona mishaps in light-weight of reality that the low degrees of change (sound) that outcome, corona may be a charged centrality setbacks, and in ludicrous events, it will hurt the sections of the structure as time goes on.

Revised Manuscript Received on January 15, 2020.

Manoj Sharma, Student of Master in Technology Electrical Engineering Department, Alakh Prakash Goyal Shimla University Apgsu Shimla, H.P. India

Anand Mohan, Professor, Electrical Engineering Department Alakh Prakash Goyal Shimla University Apgsu Shimla, H.P. India

Arun Kumar Sharma, Assistant Professor, Electrical Engineering Department Alakh Prakash Goyal Shimla University Apgsu Shimla, H.P. India

Corona happens on a huge style of transmission strains, associate how it has every one of the reserves of being extensively an extending collection of prominent in superfluous voltages (for example 400 kV) and better all-around cost.

Extra down viable condition, the detectable from corona is minor and saw once in a very however. Through wet and wet conditions, the globules of water mix set up together at the conductor increment the development of corona. Underneath this model an observable uproar is perceived that even have blast of delicate violet shade in conductors [5]. The corona ascends out of the fortuitous stage given underneath:

- Electric transmission lines will create a little measure of sound power because of corona.
- Electrical control utility-based absolutely affiliations have gigantic endeavour to pass on down the degree of corona since it offers low rackets degree while made in controlled entirety. Be that since it is set up to, in unprecedented or radiant cases, it might harm the atmosphere of the transmission pursues [7].

- It addresses the technique that associates with the aggregate of the strains of transmission, in any case it's miles a little bit at a time obvious at higher voltages as accomplice model 400 kV or higher than voltage. In standard states of air, the change made by infers that of corona isn't seen.

In event of wet and dampish conditions, the specks are amassed over the skin of the conductor which they also increment the movement of corona. Underneath such conditions, a muttering or pop stable is perceptible in start region of the road [1] [2]. 1.1 Corona Influences The corona impact happens a portion of the time in delicate of the infers that air is surely not a perfect guardian organized of a couple for zero out of pocket build up and electrons underneath ordinary cases [12]. At the issue once an imperativeness discipline is made huge all around between transports, the free electrons and particles inside the enhancing air can practice a power. By temperance of this outcome, the free electrons and besides the particles get intensified and bolted the other way. The charged pollutions all through their improvement crash into each other and what's a huge amount of with uncharged slight moving substances [12]. These strains the live of charged particles fast can augment. Inside the occasion if the electrical recorded is adequate enduring, a non-conductor separate of air can occur and a turn will kind a portion of the courses. At the explanation while limit capability of a work structure is maintained transversely over of the transmitters having great domains as in association with channel estimations, if the executed voltage is low there's no kind of apparent adjustment inside the common circumstance of air that consolidates the wires. The headway of violet sparkle, mumbling clatter related age of gas in an overhead conductor is thought as corona [2] [10]. Corona event is routinely a huge amount of reasonable



Forecast of Corona Losses using Grey Wolves on Variant Load Condition

by techniques for muttering turmoil, development of gas, and quality disaster quality losses.

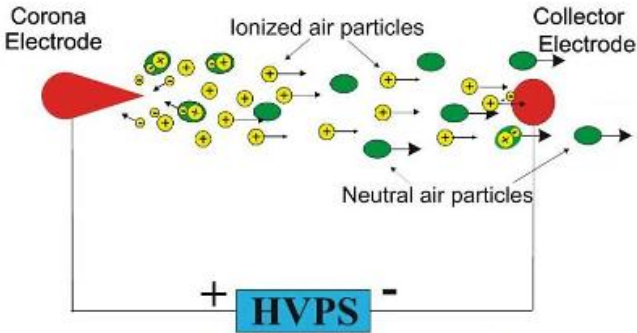


Fig.1. Corona perception between HV lines

On the off chance that conductors are smooth and cleaned, the corona coming about shimmer will be of uniform in nature all through the conductor length, in other case, sporadic (unforgiving) focuses will have every one of the reserves of being progressively marvellous. With direct current (DC) voltage, there happens a capability in two wires appearance [14] [15]. The negative transmitter wire contains a spotty gleam while the positive wire makes a uniform shimmer. The transmission of electric power handles most of power move, from making stations found different kilometres from the fundamental utilize urban zones or the centre interests. For such an explanation, the long transmission channels are viewed as the most chief expected for successful electric power move which obviously prompts huge lacks over the structure. Confining these sorts of criticalness lossess is a standard challenges for the influence masters [14]. Corona discharge can generally diminish the practicality of extra high Voltage (EHV) lines in charge structure.

1.2 Classification of Corona

Corona can bunch as an after ways:

(a) When a propensity of around 20kV rms/cm is gone to, a light or shine is discharged. The presence of flicker tends to a shocking light shine includes sharp factors that won't make unacceptable Television Interference/Radio Influence voltage (TVI/RIV) or trigger any reasonable hub.

(b) Losses dependent on a negative uttermost point "brush" happens at around 25kV rms/cm. It is named as the appearance resembles the circuitous bits of the container. The noticeable and clear aggravation related with brush-corona is customarily a method with racket in foundation, a sort of muttering or murmuring hullabaloo.

(c) Losses subject to a positive farthest point based pinnacle corona is ordinarily made at an inclination of around 30kV rms/cm consequently named in perspective on its general resemblance to tuft. Right when seen around evening time it joins a rich stem that associations and branches authentically into a tree like, violet-hid corona. The indisputable uproar made by tuft corona is a genuinely solid muttering and snapping sound. Tuft corona makes a basic Television deterrent/Radio effect voltage

1.3 Working of Corona

1. A reasonable particle or particle, in an area of solid electrical field (like the enormous potential inclination near the curved or wound terminal) is regularly ionized just by commonplace characteristic occasion (for example, getting

struck by an unending bar iota or maybe a splendid photon), to make futile out of pocket electron and a positive atom.

2. The electric field revives these oppositely charged particles in reverse manners, disconnecting them, foreseeing their recombination, and allowing dynamic imperativeness to all of them.

3. The glimmer of the corona is achieved by electrons recombining with positive particles to outline impartial atoms. Exactly when the electron falls back to its interesting essentialness level, it releases a photon of light. The photons serve to ionize various particles, keeping up the creation of electron heavy slides.

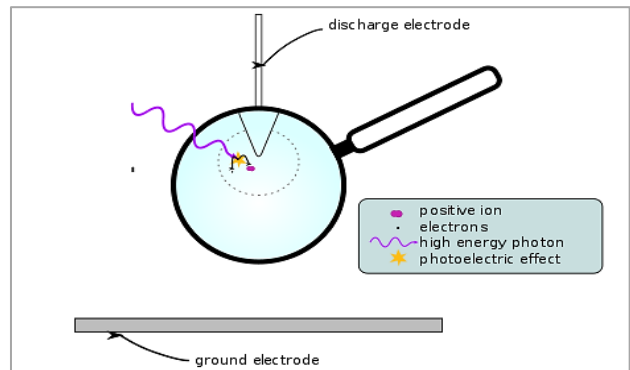


Fig.2. Commence of Corona

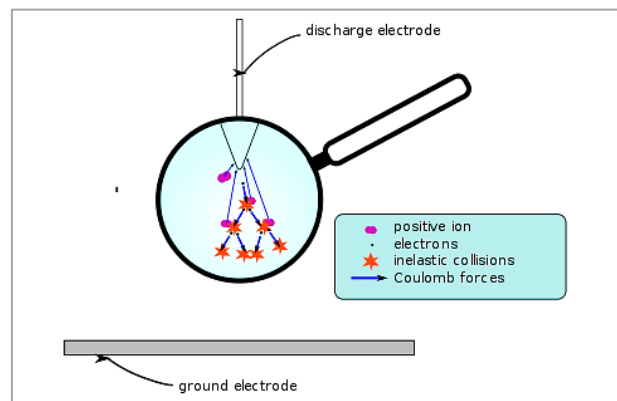


Fig.3. Electrical Dissolution

These sorts of electrons are really charged and strike to particles, making positive-atom/electron unites further, and these sorts of electrons conflict with an expansion of particles, in a string response theory named as electron overwhelming slide [7] [8]. When a positive corona is open the entirety of the electrons are pulled in inside toward the manner in which is the heading of positive terminal and particles present are repelled the outward way. Inside a positive state of corona the entire of the electrons are pulled in internal the course of the decidedly amassed cathode and the particles are stunned outward. In a negative sort of corona, the particles get pulled in where it matters most and the electrons are regularly repulsed outward way.

4. Corona shimmer is irrefutably an immediate consequence of recombination of electrons close by decidedly created particles to make particles in fair structure [9] [26]. In case there should rise an occasion of falling back of the electron again to its concealed degree of noteworthiness acknowledge appearance of a photon.

The photons work in ionizing the extra particles, saving the blueprint of electronic overwhelming slides.

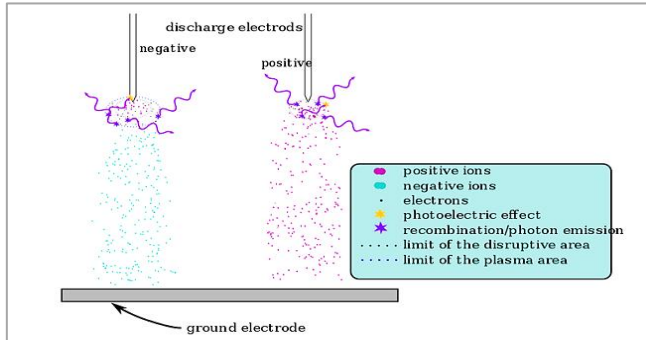


Fig. 4. Maintenance and Recombination of discharge

5. From a specific range in the anode, the electric power field winds up being low to such an extent, that it isn't any undeniably arranged to make enough vitality for the electrons for the ionization of particles on the off chance that they by and large mallet into one another. This is really the outside edge in the corona. Outside this the particles try the air without making new particles. Outside moving particles are hauled in out of nowhere cathode in end lands at it and get got together with electrons from the terminal to have the choice to turn out to be reasonable particles in the end, in this way finishing the circuit [4].

II. RELATED WORK

V.B Reddy, et.al. [1] Elaborated the size of ionic current fluctuates with the tallness of the conductor. As the tallness of the conductor expands, the size of ionic current is decreased and the other way around. It is seen that ionic current progression of a high voltage direct current (HVDC) line at real field conditions has immense varieties in greatness, relies upon air conditions. This shows the air parameters, for example, temperature, pressure, wind speed, dampness, and so on., have the huge impact in the age of particles in the region of the HVDC transmission lines. Enock Chambile, et.al [2] reviewed a study on the direct non-generation greenhouse gas emissions in the construction and operation of the national electrical power transmission and distribution (T and D) system was conducted in order to understand its impact on climate change. The results revealed that the impact of the distance of T and D lines to the greenhouse gas emissions, due to vegetation removal, is insignificant. This will finding show that, Kenya is the lowest emitter in study area with the highest average flow of electricity; compared to Rwanda with the lowest average flow of electricity. Ileana Baran et.al [3] presented the first results of an extended analysis based on synchronously recorded electrical and weather data, aimed to numerically evaluate the stochastic variation of transmission power losses measured on a given 400 kV line, in correlation with different environmental influence factors such as air temperature and pressure, dew point, wind speed and direction, type and amount of precipitation reported at 14 meteorological stations. WS Li, et.al [4] focused on transmission and storage solutions intended to reduce power loss and energy waste in electric power systems, especially in smart grid (SG) systems, and propose a novel concept for designing the infrastructure of an SG that can improve the performance of the power system. We studied a variety of

modern technologies, including high-voltage direct current (HVDC), high-voltage alternating current (HVAC), and distributed storage. After comparing the characteristics of HVDC and HVAC systems, the experts have found that it is preferable for HVDC to be included in transmission systems for long distance power delivery. Qiusheng, et.al [5] proposed an offline noise suppression method for HVDC corona current measurements. Given that the corona current and background noise processes coexist within the same frequency band, we develop a novel multifaceted filtering approach for HVDC corona currents. Specifically, a cross correlation function-based center frequency recognition method is presented to provide filter design specification for a multiple notch filter to suppress narrow-band radio interference. Xuebao Li, et.al [6] conducted a series of experiments by measuring the time-domain waveforms of the audible noise from a single corona source under DC and AC voltage. Sound pressure pulses are extracted from a correlation analysis, and then a detailed comparison of the basic characteristics of DC and AC corona-generated AN in time-domain and frequency spectrum is given. Results from this paper stand to contribute to an explanation of existing results in ANN measurement and analysis from DC and AC transmission lines. Yang Liu, et.al [7] proposed a theoretical model based on the motion of the space-charge clouds. Analysis with the model gives explanations to the experimental results and reveals some new insights into the physical mechanism of positive intermittent corona. OUYANG Jiting, et.al [8] experimentally investigated negative corona in air using a needle-to-plate electrode. The experts also measured the frequency, current, and discharge voltage of Trichel pulses using digital oscilloscope, and average discharge current using micro-ampere-meter. Through connecting capacitance in parallel to the discharge structure, we also investigated the influence of external capacitance on the discharge. Jaroslav Julák, et.al [9] described and particularly explains a new phenomenon of persistent microbicide effect of water previously exposed to the low-temperature plasma, which cannot be attributed to the acidification only. The direct microbicide action of plasma is well documented, being mediated by number of reactive particles with a short lifetime. However, the expert observed the microbicide effect also in exposed water stored for a month, where it must be mediated by stable particles. Lan Chen, et.al [10] investigated and recorded the process of corona discharge. It was found that the corona discharge turned to be much more intense when rain drops were enlarged and more compressed around the conductor. The corona inception voltage, which is an important parameter of corona discharge, was also gained using an ultraviolet imager (UV imager). The corona inception voltage under the rainy condition was about 25% lower than that under the fine condition. The results of the comparison of audible noise and radio interference were analysed.

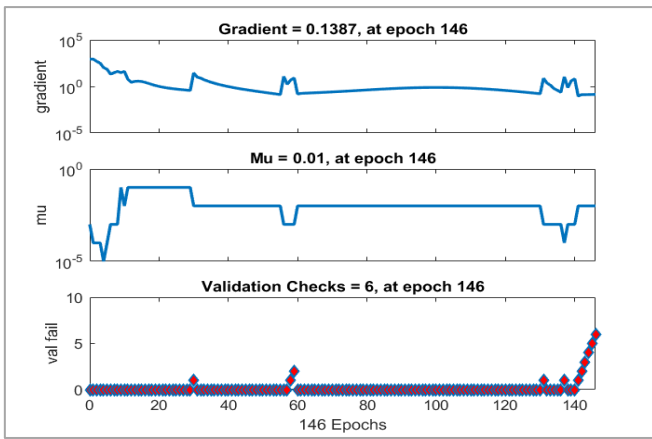


Fig. 6. Forecasted Values

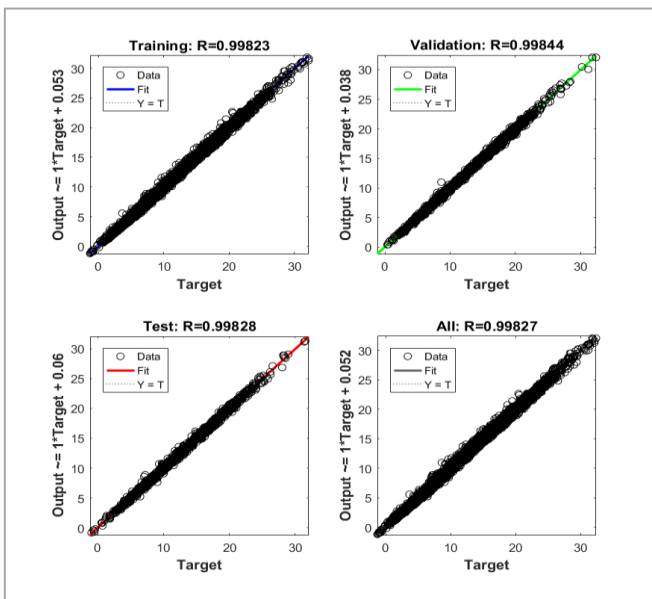


Fig.7. Forecasted values of prediction in different points
Fig.7 show the optimization of parameters at time of training, validation and there is a test to determine change in learning values and give effective output at time of testing.

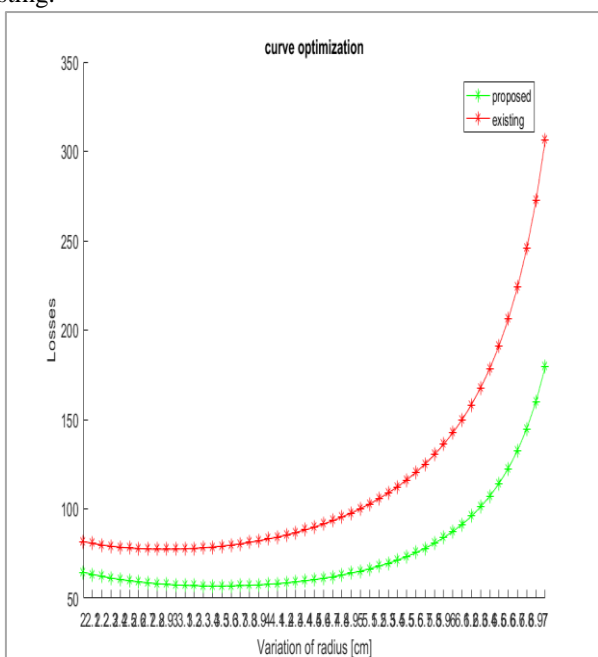


Fig.8. Corona Losses comparison on different radius

It is clear that there is an improvement in losses as proposed losses is better curve then existing one.

Table 1: Propose and existing values of Corona losses on temperature based for 2017

Temperature	Existing corona losses at 100% load	Proposed corona losses at 100% load	Existing corona losses at 110% load	Proposed corona losses at 110% load	Existing corona losses at 125% load	Proposed corona losses at 125% load
1	1.3	1.1	1.1	1.1	1.1	1.1
2	1.2	1.09	1.099	1.099	1.1495	1.0945
3	1.1	1.08	1.13	1.096	1.115	1.088
4	1.09	1.06	1.14	1.089	1.115	1.061
5	1.08	1.04	1.1	1.082	1.09	1.061
6	1.05	0.97	1.11	1.099	1.08	1.0345
7	1.04	0.96	1.2	1.1	1.12	1.03
8	0.99	0.94	0.99	0.98	0.99	0.96
9	0.98	0.92	0.99	0.97	0.985	0.945
10	0.94	0.91	0.98	0.96	0.96	0.935
11	0.9	0.88	1	0.94	0.95	0.91
12	0.86	0.85	0.98	0.96	0.92	0.905
13	0.87	0.82	0.99	0.97	0.93	0.895
14	0.82	0.78	0.98	0.98	0.9	0.88
15	0.8	0.77	1	0.94	0.895	0.835
16	0.78	0.76	0.94	0.91	0.86	0.835
17	0.8	0.75	0.9	0.89	0.85	0.82
18	0.81	0.79	0.94	0.88	0.875	0.835
19	0.82	0.8	0.98	0.85	0.9	0.825
20	0.85	0.82	0.89	0.86	0.87	0.84
21	0.86	0.84	0.9	0.89	0.88	0.865
22	0.82	0.79	0.84	0.79	0.83	0.79
23	0.8	0.78	0.85	0.78	0.825	0.78
24	0.79	0.76	0.87	0.76	0.83	0.76
25	0.78	0.77	0.85	0.79	0.83	0.77
26	0.83	0.8	0.83	0.8	0.83	0.8
27	0.85	0.83	0.89	0.83	0.87	0.83
28	0.83	0.82	0.9	0.82	0.865	0.82
29	0.84	0.81	0.93	0.81	0.885	0.81
30	0.83	0.8	0.88	0.82	0.865	0.8

Data when entered to the MATLAB it will give the output which gives the differences between proposed and existing losses at different loads. Based on these data the graph between Temperature and corona losses at 100 %, 110% and 125% loads can be drawn.

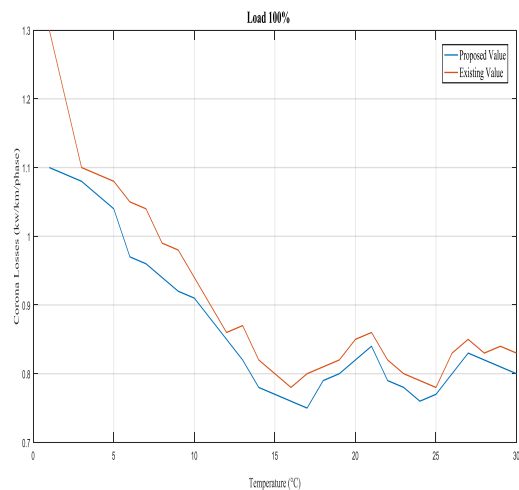


Fig.9. Difference in losses with respect to temperature at 100% load

At 100% load graph is shown between proposed and existing values, so we can see the differences between both the values.



Forecast of Corona Losses using Grey Wolves on Variant Load Condition

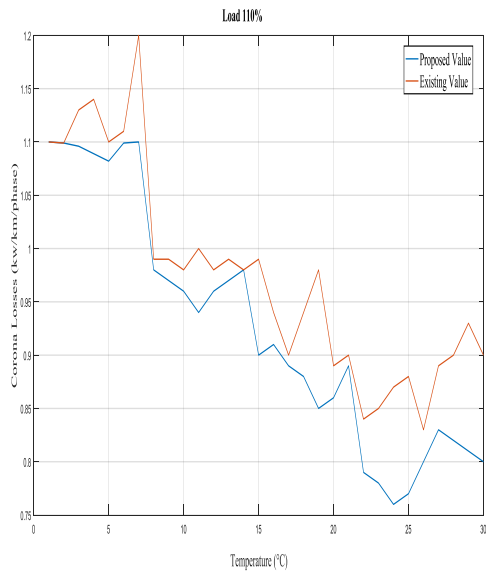


Fig.10 Difference in losses with respect to temperature at 110% load

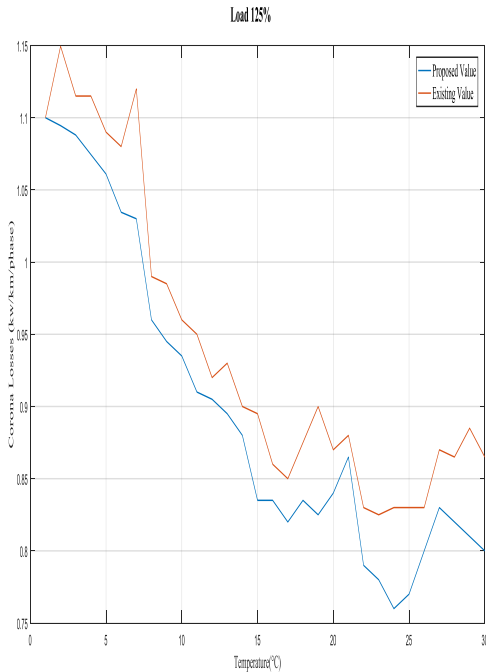


Fig.11. Difference in losses with respect to temperature at 125%

Fig. 9, 10 and 11 show the corona losses for 2017. These losses depend upon temperature impacts. This paper examines how to reasonably fluctuate the temperature and lessening the losses. These figures analyze the exhibition of expectation base (existing) and ANN learning base (proposed) approach. In test three situations of 100%, 110% and 125% burden on transport framework are taken. The analysis shows that heap doesn't influence corona losses however climate impacts corona losses.

Table 2: Proposed and existing values of corona losses on temperature based for 2018

Temperature	Existing corona losses at 100%load	Proposed corona losses at 100%load	Existing corona losses at 110%load	Proposed corona losses at 110%load	Existing corona losses at 125%load	Proposed corona losses at 125%load
1	1.5	1.3	1.3	1.3	1.3	1.3
2	1.4	1.1	1.111	1.111	1.1498	1.0948
3	1.3	1.09	1.16	1.098	1.118	1.09
4	1.12	1.08	1.17	1.092	1.118	1.0748
5	1.11	1.06	1.13	1.084	1.11	1.063
6	1.08	0.99	1.15	1.1111	1.1	1.0348
7	1.06	0.98	1.5	1.3	1.15	1.06
8	1.01	0.96	1.32	1	1.02	0.99
9	1	0.95	1.11	0.99	0.988	0.948
10	0.96	0.93	1	0.98	0.99	0.938
11	0.93	0.9	1.12	0.96	0.98	0.93
12	0.89	0.88	1	0.98	0.95	0.908
13	0.9	0.84	1.1	0.99	0.96	0.898
14	0.85	0.8	1	1	0.92	0.9
15	0.82	0.79	1.3	1.1	0.899	0.838
16	0.81	0.78	0.96	0.93	0.89	0.838
17	0.82	0.77	0.93	0.91	0.88	0.85
18	0.83	0.81	0.96	0.9	0.878	0.838
19	0.85	0.82	0.97	0.88	0.93	0.828
20	0.88	0.84	0.92	0.87	0.9	0.86
21	0.87	0.86	0.94	0.91	0.91	0.868
22	0.85	0.81	0.86	0.81	0.86	0.82
23	0.82	0.8	0.87	0.8	0.828	0.8
24	0.81	0.78	0.9	0.78	0.86	0.78
25	0.8	0.79	0.91	0.74	0.85	0.79
26	0.85	0.82	0.84	0.82	0.85	0.82
27	0.88	0.85	0.92	0.86	0.9	0.85
28	0.86	0.84	0.93	0.84	0.868	0.84
29	0.85	0.83	0.84	0.83	0.888	0.85
30	0.86	0.82	0.92	0.85	0.868	0.83

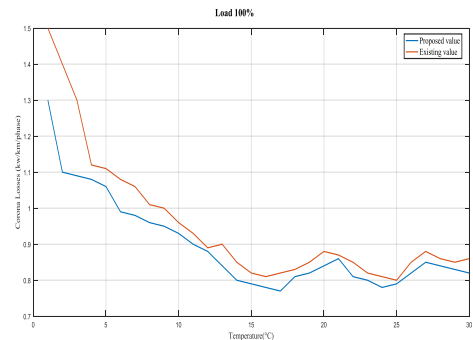


Fig.12. Difference in losses with respect to temperature at 100% load

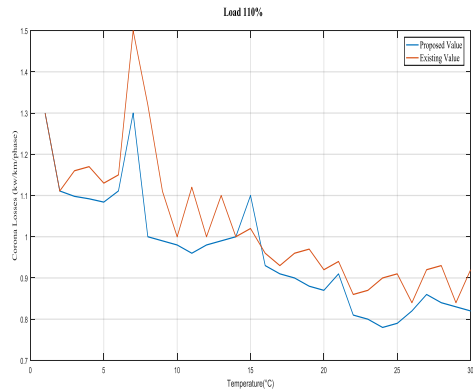


Fig.13. Difference in losses with respect to temperature at 110% load

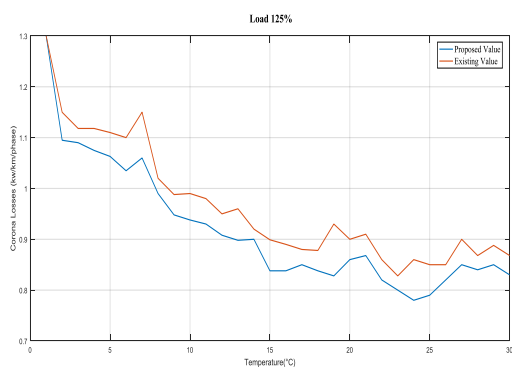


Fig.14. Difference in losses with respect to temperature at 125% load

Fig. 12, 13 and 14 show the corona losses for 2018. These losses depend upon temperature impacts. This paper assessments how to satisfactorily furcate the temperature and diminishing the losses. These figures take a gander at the introduction of gauge base (existing) and ANN learning base (proposed) approach. In attempt three circumstances of 100%, 110% and 125% weight on transport system are taken. The preliminary shows that store doesn't impact corona disasters anyway atmosphere impacts corona losses. Fig. 12, 13 and 14 show the corona losses for 2018. These losses depend upon temperature impacts. This paper assessments how to suitably furcate the temperature and lessening the losses. These figures consider the introduction of desire base (existing) and ANN learning base (proposed) approach. In test three circumstances of 100%, 110% and 125% weight on transport structure are taken. The investigation shows that weight doesn't impact corona losses yet atmosphere impacts corona losses.

Table.3. Forecasting of Corona Losses for 2017 at 100% Load

Temperature (°C)	Existing Losses (kw/km/phase)	Predicted Losses (kw/km/phase)	MAPE (%)
5	1.08	1.04	3.7
10	0.94	0.91	3.1
15	0.8	0.77	3.75
20	0.85	0.82	3.5
25	0.78	0.77	1.3
30	0.83	0.8	3.6

Table.4. Forecasting of Corona Losses for 2017 at 110% Load

Temperature (°C)	Existing Losses (kw/km/phase)	Predicted Losses (kw/km/phase)	MAPE (%)
5	1.1	1.082	1.63
10	0.98	0.96	2
15	1	0.94	6
20	0.89	0.86	3.4
25	0.85	0.79	7
30	0.88	0.82	6.8

Table.5. Forecasting of Corona Losses for 2017 at 125% Load

Temperature (°C)	Existing Losses (kw/km/phase)	Predicted Losses (kw/km/phase)	MAPE (%)
5	1.09	1.061	2.6
10	0.96	0.935	2.5
15	0.895	0.835	6.7
20	0.87	0.84	3.4
25	0.83	0.77	7.2
30	0.865	0.8	7.5

Table.6. Forecasting of Corona Losses for 2018 at 100% Load

Temperature (°C)	Existing Losses (kw/km/phase)	Predicted Losses (kw/km/phase)	MAPE (%)
5	1.11	1.06	4.5
10	0.96	0.93	4.1
15	0.82	0.79	3.6
20	0.88	0.84	4.5
25	0.81	0.79	2.4
30	0.86	0.82	4.6

Table.7. Forecasting of Corona Losses for 2018 at 110% Load

Temperature (°C)	Existing Losses (kw/km/phase)	Predicted Losses (kw/km/phase)	MAPE (%)
5	1.13	1.084	4
10	1	0.98	2
15	1.3	1.1	15
20	0.92	0.87	5.4
25	0.91	0.74	7.6
30	0.92	0.85	7.6

Table.8. Forecasting of Corona Losses for 2018 at 125% Load

Temperature (°C)	Existing Losses (kw/km/phase)	Predicted Losses (kw/km/phase)	MAPE (%)
5	1.11	1.063	4.2
10	0.99	0.938	5.2
15	0.899	0.838	6.7
20	0.9	0.86	4.4
25	0.85	0.79	7.1
30	0.868	0.83	4.3

Forecast of Corona Losses using Grey Wolves on Variant Load Condition

These are the calculation of MAPE for 2017 and 2018 at 100%, 110% and 125% loading. Table 9 compares both the corona losses for 2017 and 2018.

Table.9. Comparison of 2017-2018 Corona Losses at different Loads

Temperature (°C)	At 100% load		At 110% Load		At 125% Load	
	2017	2018	2017	2018	2017	2018
5	3.7	4.5	1.63	4	2.6	4.2
10	3.1	4.1	2	2	2.5	5.2
15	3.75	3.6	6	15	6.7	6.7
20	3.5	4.5	3.4	5.4	3.4	4.4
25	1.3	2.4	7	7.6	7.2	7.1
30	3.6	4.6	6.8	7.6	7.5	4.3

V. CONCLUSION

Obvious majority of the data strategy change provides for liberally that's only the tip of the iceberg precised affirmation of the relationship between transmission mishaps and its influencing parts, including corona hypothesis, along these lines moving forward those precision about theory. Those test evaluation serves On enhancing the setbacks from claiming ANN-based Taking in technique done examination of have any desire based frameworks. In the suggested strategy close execution about weigh build (existing hardships) and ANN Taking in base (proposed disasters) methodologies will be done. The appraisal examination depended separate states stacks for case 100%, 110% Furthermore 125% on a structure transport. Those aftereffects of the suggested method for speculation show that the store doesn't influence corona adversities yet atmosphere affects with respect to corona disasters. Those MAPE picked to 2017 Furthermore 2018 is under 10% which is a remarkable need procedure got out to Lewis foreseeing technique.

REFERENCES

1. Prameela, M., K. Vijay Bhaskar Reddy, N. Bhopal, and Narsapur Medak "Effects of atmospheric temperature on corona generated ionic currents of HVDC Transmission lines" International Journal of Pure and Applied Mathematics Vol. 118, No. 24 2018 (2018).
2. Balametov, Ashraf, Elman Halilov, and TaranaIsayeva. "Extra high voltage transmission line operation simulation using the actual corona-loss characteristics." Turkish Journal of Electrical Engineering & Computer Sciences 26, no. 1 (2018): 479-488.
3. Huang, Shilong, Yunpeng Liu, Shaoshuai Chen, Guangyang Zhou, and Wenbing Zhuang "Corona Onset Characteristics of Bundle Conductors in UHV AC Power Lines at 2200 m Altitude." Energies 11, no. 5 (2018): 1-14.
4. Skin Effect [Online]. <https://circuitglobe.com/skin-effect.html> [Assessed on 19-April-2019]
5. Li, W. S., S. GAO, L. Ding, Z. F. Wang, and Z. H. Liu "Solutions for the Transmission and Storage of Electric Power "In 2018 4th International Conference on Electrical Energy Systems (ICEES), pp. 208-211.IEEE, 2018.
6. Yutthagowith, Peerawut, Thang H. Tran, Akihiro Ametani, Yoshihiro Baba, and Vladimir A. Rakov "Application of a Simplified Corona Discharge Model to a Lightning Surge Simulation with the PEEC

- Method " In 2018 34th International Conference on Lightning Protection (ICLP), pp 1-4 IEEE, 2018.
7. Yin, Fanghui, MasoudFarzaneh, and Xingliang Jian "Corona investigation of an energized conductor under various weather conditions." IEEE Transactions on Dielectrics and Electrical Insulation 24, no. 1 (2017): 462-470.
8. CoronaDischarge.[Online].https://en.wikipedia.org/wiki/Corona_discharge [Assessed on 19-April-2019] .
9. What is Corona Effect of Transmission Line and How to Overcomeit?[Online].<http://www.electricalpowerenergy.com/2018/02/21/corona-effect/> [Assessed on 19-April-2019]
10. Sajir, Husham, JavadRahebi, Amir Abed, and Ali Farzammia. "Reduce power losses and improve voltage level by using distributed generation in radial distributed grid." In Automatic Control and Intelligent Systems (I2CACIS), 2017 IEEE 2nd International Conference on pp. 128-133 IEEE 2017.
11. Zhang, Lu, Ying Chen, Chen Shen, Wei Tang, and Jun Liang "Releasing more capacity for EV integration by DC medium voltage distribution lines." IET Power Electronics 10, no. 15 (2017): 2116-2123.
12. Corona effect and discharge in Transmission lines and Power\systems.[Online]<https://www.electricaltechnology.org/2018/02/corona-effect-discharge-transmission-lines-power-system.html> [Accessed on 17/11/2018]
13. Corona effect: Theory, Affecting Factors. [Online] <http://www.electricalbasicprojects.com/corona-effect-reduce-factors-advantage/> [20-April-2019].
14. Zou, Zhilong, Xiang Cui, Tiebing Lu, and XingmingBian "Measurement method of ionic motilities in direct current corona discharge in air." IEEE Transactions on Dielectrics and Electrical Insulation 23, no. 3 (2016): 1879-1885.
15. Chen Lan, J. M. K. MacAlpine, XingmingBian, Liming Wang, and Zhicheng Guan "Comparison of methods for determining corona inception voltages of transmission line conductors." Journal of Electrostatics 71, no. 3 (2013): 269-275.
16. Bian, Xingming, Liming Wang, Yunpeng Liu, Yingjian Yang, and Zhicheng Guan. "High altitude effect on corona inception voltages of DC power transmission conductors based on the mobile corona cage." IEEE Transactions on Power Delivery28, no. 3 (2013): 1971-1973.
17. Zhou, Xiangxian, Xiang Cui, Tiebing Lu, Yongzan Zhen, and Zhaonan Luo. "A time-efficient method for the simulation of ion flow field of the AC-DC hybrid transmission lines." IEEE Transactions on Magnetics 48, no. 2 (2012): 731-734.
18. Lewis CD "International and business forecasting methods London": Butter-worth; 1982.