

Examining the Properties of Natural Ester Oils with Antioxidants and Nano Powders for Power Applications



K. S. Lincy, S. Senthil Kumar, M. Willjuice Iruthayarajan

Abstract: In this cutting edge world, electrical vitality is the significant thing to make due on the planet. An ongoing examination has prevailed that the oil by items are accessible just for not many years. Along these lines, following barely any years substitution of mineral oil is vital because of its debasement of protection. In this paper, the oil picked is Neem oil, sunflower oil, Mahua oil and Rice grain oil is treated with antioxidants (cancer prevention agents) and nano powders. "Breakdown voltage, flash point, fire point, viscosity and acidity are estimated in consonance with principles". To diminish the oxidation security normal and manufactured antioxidants (cancer prevention agents) are liked, and Nano powders are additionally utilized for improving the properties of the oil. Engineered cell reinforcements, for example, Beta Carotene and TBHQ and selenium are favored as normal cancer prevention agents. When the expansion of cancer prevention agents and nano powders the estimations were finished. After cancer prevention agents and Nano powders are included, the property of the transformer oil is expanded. By doing this investigation, the transformer oil is utilized for reuse reason and it has a more extended lifetime.

Index terms: Antioxidants, Acidity, Break down Voltage, Flash Point, Fire point, Nano powders, Viscosity

I. INTRODUCTION

Transformer oil is used for insurance reason. It is gotten by oil results in this manner it is named as mineral securing oil. Transformer oil fills fundamentally two needs one it is liquid insurance in electrical power transformer and two it scatters warmth of the transformer that is it goes about as a coolant. It moreover helps in another two reasons, one to secure the middle and winding as these are totally doused inside oil, and next preventing the prompt contact of air oxygen [1].

Naphtha oil gets more successfully oxidized than Paraffin oil. Seepage plan present in the naphtha oil is more when

stood out from paraffin oil [2]. Appropriately sludge isn't confined in the base of the transformer and doesn't furious the cooling game plan of the transformer. Yet, because of Paraffin oil regardless of the way that the oxidation rate is lower. In spite of the way that Paraffin-based oil has a shortcoming since we use it because of its straightforward availability. High pour point issue is found in paraffinic oil on account of the wax content, anyway this doesn't impact its use in view of warm air territory of India [3-5].

An Antioxidant is the concoction mixes which can defer the beginning or moderates the pace of lipid oxidation response in nourishment frameworks both normal and manufactured cell reinforcements are utilized in the nourishment business as nourishment added substances. Oxidative degeneration is expressed to have been brought about by unsafe particles called free radicals. Free radicals are atomic parts having at least one unpaired electrons [6-8].

Nanopowders are characterized as powdered materials with singular particles having sizes less than 100 Nanometers. The particles present in the nanopowders are extremely littler when contrasted and the wavelength of unmistakable light [9-10]. The littler size of nanopowders gives them an amazingly high surface territory to volume proportion that outcomes in unprecedented properties like outrageous quality. Underneath recipe is utilized to ascertain the quantity of nanoparticles to be included with the oil for planning of nanofluids:

Weight of the nanoparticles = (density * Volume) / (Volume Fraction).

II. EXPERIMENTAL PROCEDURE

The methodology includes standards, measurements, sample description and sample preparation. Sample description and sample preparation are done for Neem oil, sunflower oil, Mahua oil and Rice bran oil.

A. Standards

The measurement of oil properties like Viscosity, Breakdown Voltage, Acidity, Flash and Fire point is carried out according to IEC and ASTM standards [11-13]. The method standard used and standard values are given in Table 1.

Manuscript received on February 10, 2020.

Revised Manuscript received on February 20, 2020.

Manuscript published on March 30, 2020.

* Correspondence Author

K. S. Lincy, Pursuing Master Degree program in High voltage Engineering, National Engineering College, Kovilpatti, Tamil Nadu, India., E-mail: 183803@nec.edu.in

***Dr. S. Senthil Kumar**, Asst Prof (SG), Department of EEE, National Engineering College, Kovilpatti, TamilNadu, India.

E-mail: senthilkumarnec@gmail.com

Dr. M. Willjuice Iruthayarajan, Prof & Head in, Department of EEE, National Engineering College, Kovilpatti, Tamil Nadu, India. E-mail: hodeee@nec.edu.in.

© The Authors. Published by Blue Eyes Intelligence Engineering and Sciences Publication (BEIESP). This is an [open access](https://creativecommons.org/licenses/by-nc-nd/4.0/) article under the CC BY-NC-ND license (<http://creativecommons.org/licenses/by-nc-nd/4.0/>)

Table -1: Standards and Methodology for Measurement

Parameters	Method/Equipment	Standard
Breakdown Voltage	Breakdown Voltage Kit	IEC 60156
Viscosity	Redwood Viscometer	ASTM D-445
Flash Point and Fire Point	Pensky Martin Closed Cup Method	ASTM D-93
Acidity	Color Chart	-

B. Measurement of Breakdown Voltage

The dielectric quality of transformer oil is otherwise called the Breakdown voltage of transformer oil. The low estimation of BDV demonstrates the nearness of dampness substance and leading substance in the oil. In BDV unit, oil is kept in a pot in which one sets of the terminal is fixed with a hole of 2.5mm between them [14]. By raising the voltage estimation is taken 3 to multiple times in a similar example of oil. The breakdown Voltage testing unit is appeared in Fig.1



Fig. 1 Breakdown voltage test kit

C. Measurement of Viscosity

In fact the consistency of the oil is a proportion of the oil protection from shear. Consistency is all the more generally known as obstruction stream. The estimation of thickness the protection from stream between the individual layers [15]. A high thickness infers high protection from stream while a low consistency shows a low protection from stream. Consistency differs conversely with temperature [21].

D. Measurement of Flash and Fire Point

Flashpoint of an unpredictable fluid is the most minimal temperature at which it can disintegrate to shape an ignitable blend in air. Estimating a fluid's flashpoint requires a start source [16]. The blaze point is regularly utilized as one illustrative trait of fluid fuel, however it likewise used to portray fluids that are not utilized deliberately as fills [21].

The temperature at which the fume keeps on consuming subsequent to being lighted is called fire point. It is the most minimal temperature at which, on further warming past the blaze point the example will bolster ignition for 5 seconds. The Pensky Martins Closed Cup mechanical assembly is appeared in Fig.2.



Fig.2. Pensky Martin Closed Cup Apparatus

E. Measurement of Acidity

The acidity is determined by utilizing shading outline technique. 1.1ml of the oil test and 1ml of ethyl liquor are blended and subsequent to shaking admirably 1ml of sodium carbonate is included [17-20]. After re shaking great 5 drops of all inclusive marker arrangement is included and blended well. By utilizing the shading graph corrosive substance in oil test is found in KOH/g.

F. Sample Preparation

The Neem oil, sunflower oil, Mahua oil and sunflower oil of 500 ml is blended in with the single and mix cell reinforcements like TBHQ, selenium, beta carotene and BHT and nano powders like aluminum nitride, carbon nanopowder and calcium phosphate are blended utilizing attractive stirrer unit for 30 minutes under 750 RPM.

Table -2: Sample Preparations

Sample	Sample Name
1	500 ml of Base fluid
2	500 ml of base fluid +1g TBHQ
3	500 ml of base fluid +1g Selenium
4	500 ml of base fluid +1g Beta Carotene
5	500 ml of base fluid + 1g BHT
6	500 ml of base fluid +0.5g Selenium +0.5g Beta Carotene
7	500 ml of base fluid + 0.5g Selenium +0.5g TBHQ
8	500 ml of base fluid + 1g calcium phosphate
9	500 ml of base fluid + 0.5g TBHQ +0.5g Beta Carotene
10	500 ml of base fluid + 0.33g Selenium +0.33g Beta Carotene+0.33g TBHQ
11	500 ml of base fluid +1g Aluminum Nitride
12	500 ml of base fluid +1g Carbon Nano Powder
13	500 ml of base fluid +0.5g Carbon Nano Powder+0.5g Aluminum Nitride

III. EXPERIMENTAL STUDIES

The experiments are conducted from the combination of Neem Oil, Sunflower Oil, Mahua Oil and Rice Bran Oil blended with regenerative materials. The critical parameters of the samples are improved and discussed in below.

A. Merger of Neem Oil with Regenerative Materials

The assessment of basic parameters of Neem Oil by method for various extents through expansion of regenerative materials like TBHQ, Selenium, Beta Carotene, Aluminum Nitride and Carbon Nano Powder were made.


Table 3 shows the after effects of Neem Oil blended in with regenerative materials.




The graphical portrayal of correlation of Breakdown Voltage and sharpness estimations of tests utilizing Neem oil are appeared in diagram 1 and 2

Table-3: The Blending of Neem Oil with Regenerative Materials

Sample	BDV (kV)	Viscosity at		Point (° C)		Acidity (KOH/g)
		40° C	90° C	Flash	Fire	
1	20	145.81	41.05	230	250	0.6
2	22.1	113.23	34.10	260	283	0.1
3	23.83	94.95	34.10	238	257	0.1
4	22.3	110.10	34.90	243	259	0.4
5	20	370	120	250	265	0.7
6	27.75	82.40	28.40	218	238	0.6
7	25.1	48.50	14.52	232	248	0.3
8	18	280	127	220	240	0.7
9	21.5	87.11	28.40	243	261	0.4
10	18.4	94.43	30.58	253	274	0.3
11	26.3	86.33	28.13	283	300	0.4
12	29	97.04	26.49	279	296	0.05
13	26.2	74.81	24.28	273	295	0.1

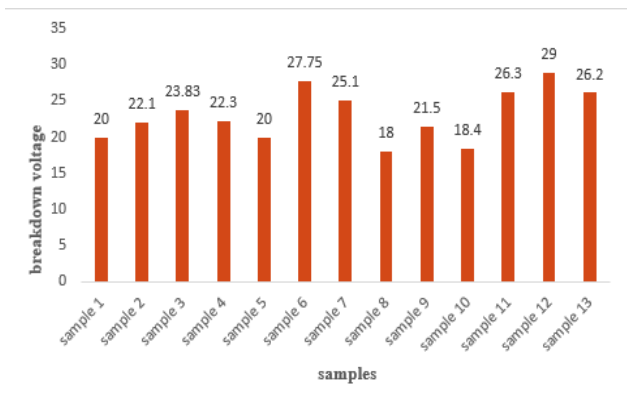

Graph 1. Relationship of Breakdown Voltage using Neem oil.

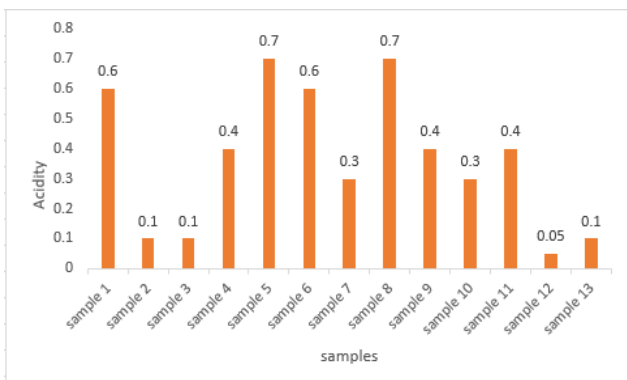


Graph 2. Relationship of Acidity using Neem oil.


B. Merger of Sunflower Oil with Regenerative Materials

The assessment of basic parameters of Sunflower Oil by method for various extents through expansion of regenerative materials like TBHQ, Selenium, Beta Carotene, Aluminum Nitride and Carbon Nano Powder were made. Table 4 shows

the consequences of Sunflower Oil blended in with regenerative materials. The graphical portrayal of examination of Breakdown Voltage and acidity estimations of tests utilizing Sunflower Oil are appeared in chart 3 and 4.

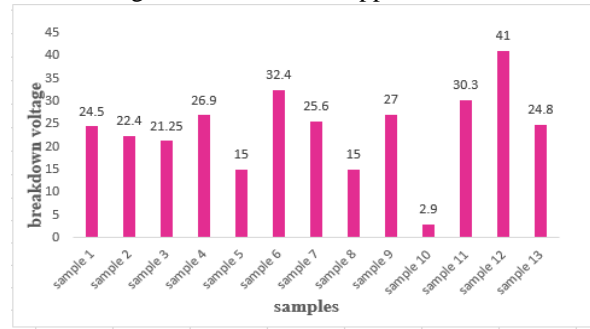

Graph 3. Relationship of Breakdown Voltage using Sunflower oil

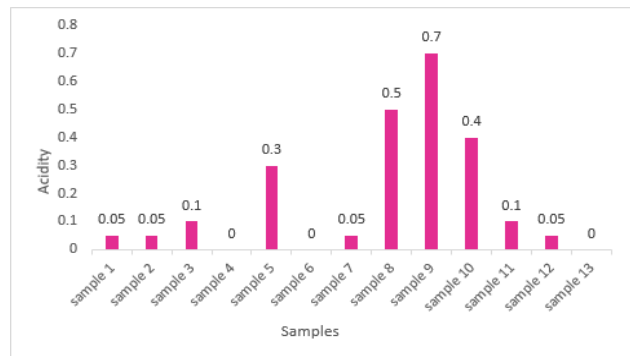

Graph 4. Relationship of Acidity using Sunflower oil.


Table-4: The Blending of Sunflower Oil with Regenerative Materials

Sample	BDV (kV)	Viscosity at		Point (° C)		Acidity (KOH/g)
		40° C	90° C	Flash	Fire	
1	24.5	42.66	26.21	>300	>300	0.05
2	22.4	115.31	52.46	>300	>300	0.05
3	21.25	90.51	25.66	>300	>300	0.1
4	26.9	75.85	26.21	>300	>300	0
5	15	285	135	250	275	0.3
6	32.4	84.49	30.04	>300	>300	0
7	25.6	90.25	26.21	>300	>300	0.05
8	15	300	180	270	290	0.5
9	27	48.50	23.72	>300	>300	0.7
10	20.9	90.51	55.1	>300	>300	0.4
11	30.3	70.87	25.94	>300	>300	0.1
12	41	66.15	20.93	>300	>300	0.05
13	24.8	91.55	23.17	>300	>300	0


C. Merger of Mahua Oil with Regenerative Materials

The assessment of basic parameters of Mahua oil by method for various extents through expansion of regenerative materials like TBHQ, Selenium, Beta Carotene, Aluminum Nitride and Carbon Nano Powder were made. Table 5 shows the aftereffects of Mahua oil blended in with regenerative materials.

The graphical portrayal of examination of Breakdown Voltage and sharpness estimations of tests utilizing Mahua oil are appeared in chart 5 and 6.

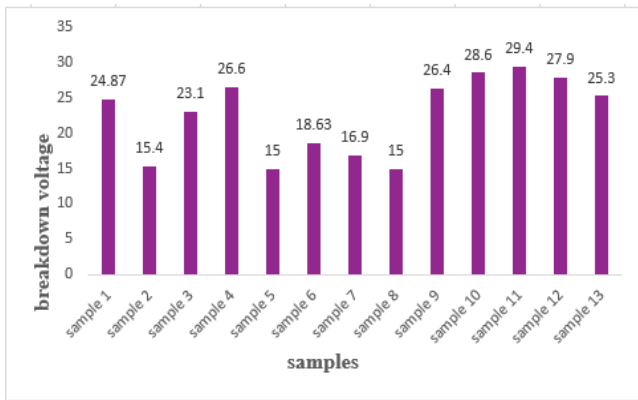

Graph 5. Relationship of Breakdown Voltage using Mahua oil.

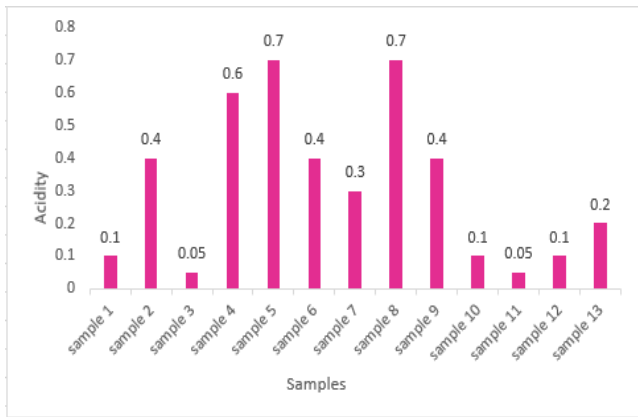

Graph 6. Relationship of Acidity using Mahua oil.

Table -5: The Merger of Mahua Oil with Regenerative Materials

Sample	BDV (kV)	Viscosity at		Point (° C)		Acidity (KOH/g)
		40° C	90° C	Flash	Fire	
1	24.87	298.53	30.85	270	290	0.1
2	15.4	80.83	30.58	240	260	0.4
3	23.1	81.88	37.85	250	268	0.05
4	26.6	96.52	27.04	258	273	0.6
5	15	285	135	250	275	0.7
6	18.63	115.05	28.13	252	269	0.4
7	16.9	103.57	30.04	280	298	0.3
8	15	300	180	270	290	0.7
9	26.4	98.35	27.04	275	294	0.4
10	28.6	123.39	31.39	>300	>300	0.1
11	29.4	109.31	46.37	290	>300	0.05
12	27.9	108.27	22.89	268	291	0.1
13	25.3	183.22	56.42	285	>300	0.2


D. Merger of Rice Bran Oil with Regenerative Materials

The assessment of basic parameters of Rice grain oil by method for various extents through expansion of regenerative materials like TBHQ, Selenium, Beta Carotene, Aluminum Nitride and Carbon Nano Powder were made. Table 6 shows


the aftereffects of Rice wheat oil blended in with regenerative materials. The graphical portrayal of examination of Breakdown Voltage and acidity estimations of tests utilizing Rice grain oil are appeared in chart 7 and 8.

Table -6: The Merger of Rice Bran Oil with Regenerative Materials

Sample	BDV (kV)	Viscosity at		Point (° C)		Acidity (KOH/g)
		40° C	90° C	Flash	Fire	
1	35	285	120	340	355	0.4
2	20	400	120	340	360	0.3
3	30	370	150	280	330	0.7
4	25	480	110	220	250	0.8
5	25	210	110	320	335	0.4
6	20	350	100	315	320	0.4
7	25	365	115	290	325	0.6
8	15	340	135	320	330	0.7
9	25	395	138	315	335	0.5
10	30	380	135	300	330	0.6
11	25	465	225	300	320	0.6
12	20	390	130	280	320	0.3
13	28	385	130	320	330	0.4

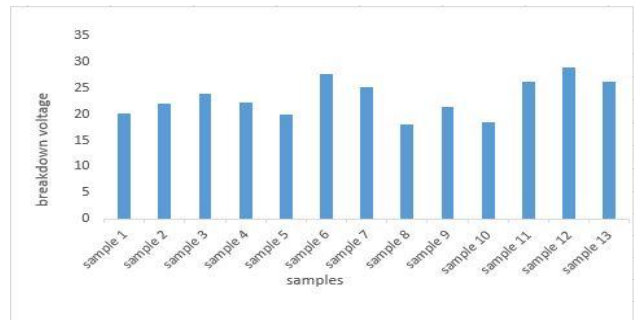

Graph 7. Relationship of Breakdown Voltage using Rice Bran oil.

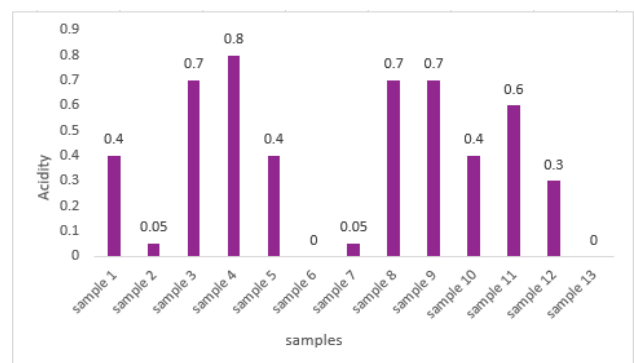

Graph 8. Relationship of Acidity using Rice Bran oil.

IV. RESULT AND DISCUSSION

In this work, Neem oil, Sunflower Oil, Mahua oil and Rice Bran oil are mixed in different proportions with Antioxidants and Nano Powders. From Tables 3, 4, 5 & 6 we observe that the BDV, Flash Point and Fire point temperatures have decreased and increased considerably with minimum and maximum change in the viscosity after addition of the Selenium, TBHQ, Beta Carotene, Aluminium Nitride and Carbon Nano powder. From the results, it can be shown that after contacting the Neem oil with regenerative materials the Breakdown Voltage is increased from 184.4 kV to 29 kV. The Flash Point is increased from 218⁰C to 283⁰C and the Fire Point is increased from 238⁰C to 300⁰C. The viscosity value gets decreased in 40⁰C and 90⁰C temperatures. Due to the mixture of Sunflower Oil with regenerative materials the Breakdown Voltage is increased from 21.25 kV to 41 kV. The Flash Point is greater than 300⁰C for all samples and the Fire Point is greater than 300⁰C. The viscosity value gets decreased in 40⁰C and 90⁰C temperatures. Due to the combination of Mahua Oil with regenerative materials the Breakdown Voltage is increased from 15.4 kV to 29.4 kV. The Flash Point is increased from 240⁰C to 300⁰C and the Fire Point is increased from 260⁰C to 300⁰C. The viscosity value gets decreased in 40⁰C and 90⁰C temperatures.

V. CONCLUSION

Transformers are the most important part in the electrical force framework. The investigation is utilized to set up the resurgence of vegetable oil. In addition the mix of cancer prevention agents (TBHQ, Selenium, BHT, Beta Carotene) and Nano Powders (Aluminum Nitride, Calcium phosphate, Carbon Nano Powder) is a demonstrated method for improving the properties of vegetable oil. The significant highlights of utilizing cell reinforcements and nano powders blend during experimentation separated from upgrade property are exceptionally less carbon content during breakdown. After the expansion of regenerative materials, the parameters, for example, BDV, Viscosity, Flash point and Fire point gets expanded. This methodology is in addition expensive in evading unsafe transfer of utilized transformer oil to condition. By and large inspection infers that the upgraded oils utilizing regenerative materials, nano powders and cancer prevention agent is a fitting answer for potential reuse in power transformer.

REFERENCES

1. C. Perrier, A. Beroual, J. L. Bessede. "Improvement of Power Transformer by using Mixtures of Mineral Oil with Synthetic Esters", IEEE Transactions on Dielectrics and Electrical Insulation, Vol. 13, 2013
2. S. Senthil Kumar, M. Willjuice Iruthayarajan and M. Bakruthen, "Investigations on Suitability of Rice Bran Oil and Corn Oil as Alternative Insulating Liquid for Transformers", IEEJ Transactions on Electrical and Electronic Engineering, Vol. 11, No. 1, pp. 10-14, 2016.
3. Viet-Hung Dang, A. Beroual, C. Perrier "Comparative Study of Statistical Breakdown in Mineral, Synthetic and Natural Ester Oils under AC Voltage", IEEE Transactions on Dielectrics and Electrical Insulation Vol. 19, pp. 20-29.
4. T.V. Ommen, "Vegetable Oils for Liquid Filled Transformers", IEEE Electrical Insulation Magazine, Vol. 18, No.1, pp. 6-11, 2002.
5. Matharage, Fernando, Bandara, Jayantha and Kalpage, "Performance

- of Coconut Oil as an Alternative Transformer Liquid Insulation", IEEE Transactions on Dielectric and Electrical Insulation, Vol. 20, No. 3, pp. 887-898, 2013.
6. S. Tenbohlen, "Ageing Performance and Moisture Solubility of Vegetable Oils for Power Transformers", IEEE Transactions on Power Delivery, Vol. 25, No. 2, pp. 825-830, 2013.
7. S. Senthil Kumar, M. Willjuice Iruthayarajan and M. Bakruthen, "Performance Of Activated Bentonite And Carbon In Reclaiming the Properties Of Used Mineral Oil", Journal of Electrical Engineering, 2017, Volume 17, No:3, pp. 407-415.
8. R.L. McCormick, M. Ratcliff, L. Mones and R. Lawrence, "Several Factors Affecting the Suitability of Biodiesel in Standard Accelerated Test", Fuel processing technology, Vol. 88, pp. 651-657, 2007.
9. R. Madavan, S. Senthil Kumar, M. Willjuice Iruthayarajan "A comparative investigation on effects of nanoparticles on characteristics of natural esters-based nanofluids", Colloids and Surfaces, Elsevier, 2018, No: 556, pp: 30-36.
10. S. Senthil Kumar, M. Willjuice Iruthayarajan and M. Bakruthen, "Analysis of Vegetable Liquid Insulating Medium for Applications in High Voltage Transformers", IEEE International Conference on Science, Engineering and Management Research (ICSEMR), pp. 1-5, 2014.
11. P. Boss and T.V. Ommen, "New Insulating Fluids for Transformers based Biodegradable High Oleic Vegetable Oil and Ester Fluid", IEEE Colloquium on insulating liquids, pp. 1-10, 1990.
12. I.L. Hosier, A. Guushaa, E. W. Westenbrink, C. Rogers, A. S. Vaughan and S. G. Swingler, "Aging of Biodegradable Oils and Assessment of their Suitability for High Voltage Applications", IEEE Transactions on Dielectrics and Electrical Insulation, Vol. 18, No. 3, pp. 728-738, 2011.
13. Krishnamoorthy, P. R., S. Vijayakumari, "Effect of Antioxidants and Metal Deactivator on the Oxidation of Transformer Oil", IEEE Transactions on Dielectrics and Electrical Insulation, Vol. 27, No. 2, pp. 271-277, 1992.
14. M. Mobin, M. Mobin, Z. Li, Multi-response optimization of cavitation peening parameters for improving fatigue performance using the desirability function approach, Int. J. Appl. Decis. Sci. 9 (2) (2016) 156-181.
15. R. Radha, M. Willjuice Iruthayarajan and M. Bakruthen, "Performance of natural high oleic ester based blended oil insulation for transformer", International Conference on
16. Intelligent Systems and Control (ISCO), 2016.
17. Karthik. R and Sree Renga Raja. T, "Investigations of Transformer Oil Characteristics", IEEJ Transactions of Electrical and Electronics Engineering, Vol. 7, pp. 369-374, 2012.
18. S. Senthil kumar, "Investigation of Various Natural Esters Insulating Medium for the Applications in High Voltage Machinery" International Journal of Advanced Research in Basic Engineering Sciences and Technology, ISSN (ONLINE):, Vol. 4, Issue. 5, pp: 2456-5717.
19. Dua R, Bhandari N and Kumar V., "Multi-criteria optimization for obtaining efficiently blended transformer oil", IEEE Transactions on Dielectrics and Electrical Insulation, Vol. 15.
20. S. Senthil kumar, "Examining the Properties of Neem Oil, Sunflower Oil and Mahua Oil with Antioxidants and Nano Powders for Power Transformer", American Journal of Electrical and Computer Engineering, Vol. 3, No. 1, 2019, pp. 20-29.
21. S. Senthil Kumar "Analysis of vegetable liquid insulating medium for application in high voltage transformers", ICSEMR 2014, Vel Tech Multitech Engineering college, Chennai.
22. S. Senthil Kumar, "Optimization of Various Natural Ester Oils Impregnated Nomex Paper Performance in Power Transformer Applications under Different Ageing Conditions", International Journal of Recent Technology and Engineering, 2019, Volume-8, Issue-3, pp: 6245-6251.

AUTHORS PROFILE



K.S. Lincy is currently pursuing her Master degree program in High voltage Engineering, National Engineering College, Kovilpatti, Tamil nadu, India..



Dr. S. Senthil Kumar obtained the B.E. degree in Electrical and Electronics Engineering and the M.E. degree in High-voltage engineering from National Engineering College (NEC), Kovilpatti, Tamil Nadu, India, in 1999 and 2009, respectively. He is presently as an Assistant Professor (SG) with the Department of Electrical and Electronics Engineering, NEC. His research interests include high-voltage insulation engineering and liquid dielectrics.



Dr. M. Willjuice Iruthayarajan obtained the B.E. degree in Electrical and Electronics Engineering from the Government College of Engineering, Tirunelveli, India, and the M.E. and Ph.D. degrees in Control and Instrumentation and Control Systems, respectively, from Anna University, Chennai, India. He is presently a Professor and Head of the Department of Electrical and Electronics Engineering, National Engineering College, Kovilpatti, Tamilnadu, India. He has published more than 30 papers in international journals and conference proceedings. His research Interests include control systems, Instrumentation, liquid dielectrics and evolutionary computation